




Disclaimer


This product is for reference purposes only and is not to be construed as a legal document. Any reliance on the information contained herein is at the user's own risk. The Florida Department of Health and its agents assume no responsibility for any use of the information contained herein or any loss resulting therefrom.


Florida Department of Health Bureau of Water Programs Well Surveillance Tracking System

ANALYSIS: Dieldrin

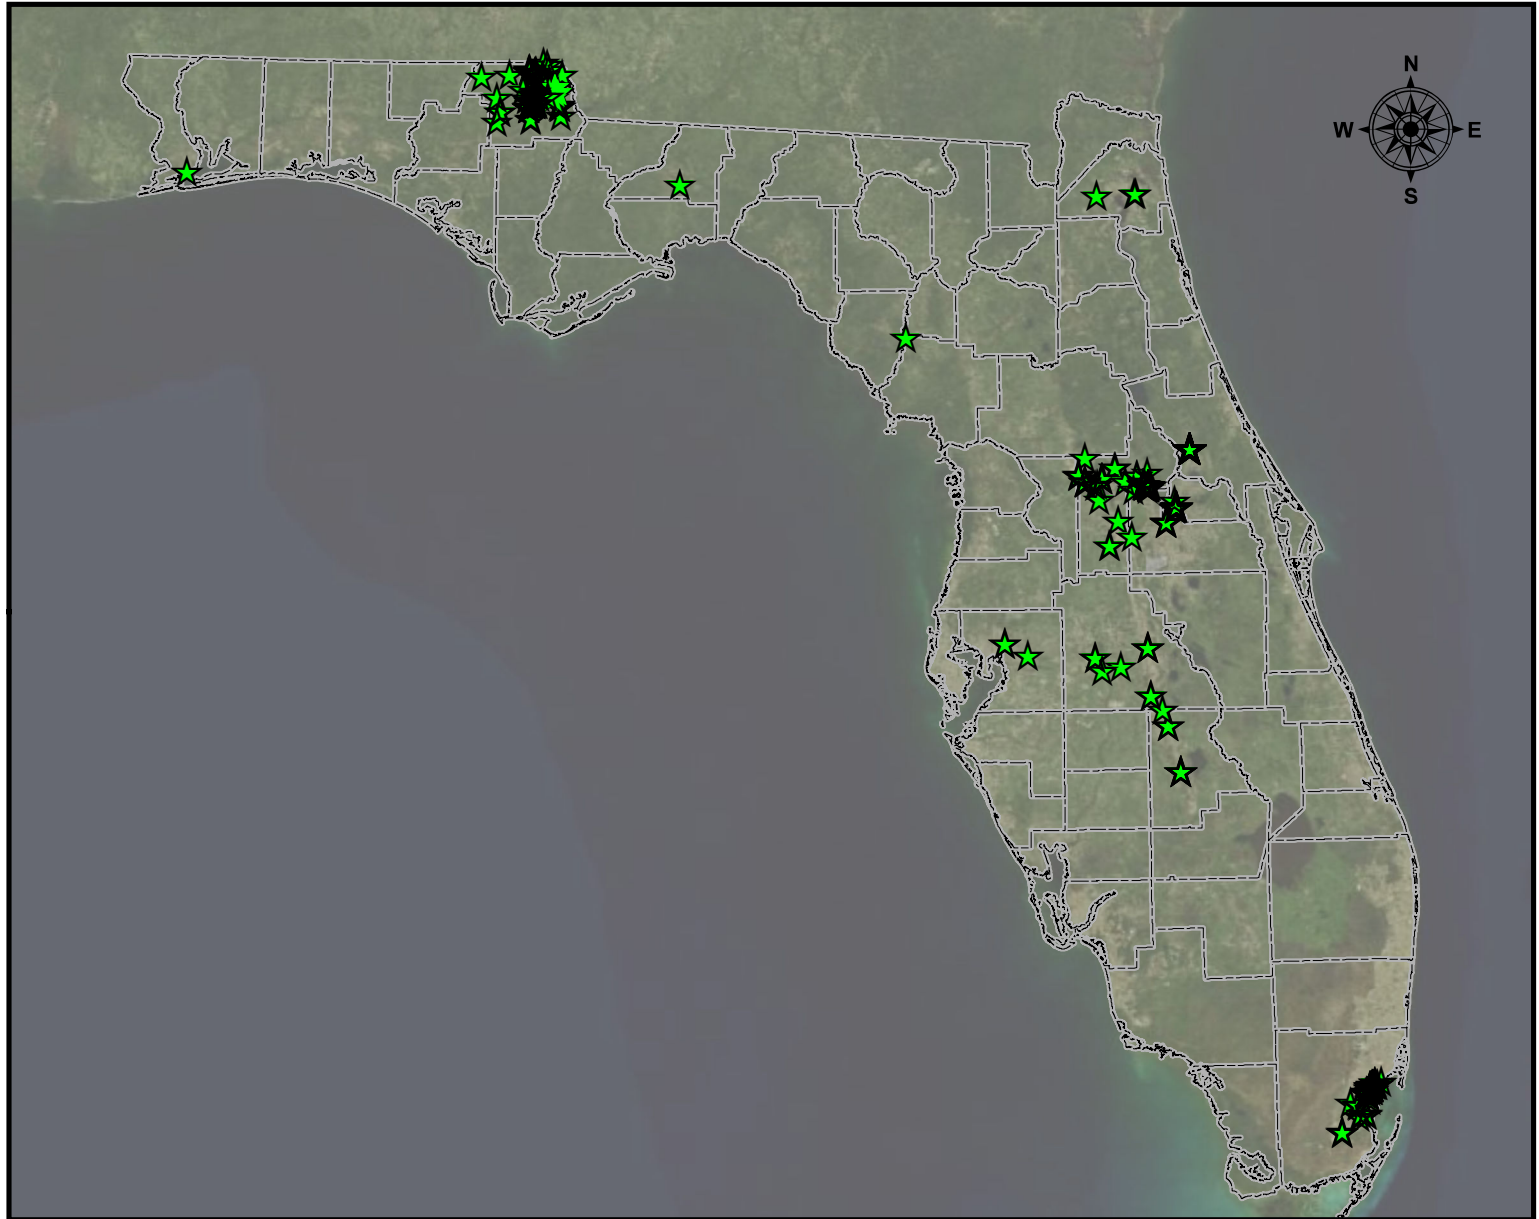

Legend

 Dieldrin greater than 0.002 ug/L



There are 390 wells that have exceeded 0.002 ug/L

8/1/2011
DonahueCR